


SECTION 'A-A'

LOOKING FROM INSIDE LOT TOWARDS SEWER MAINS

NOTES:

1. CURB BOX LOCATED ON CENTRE LINE OF LOT UNLESS SPECIFIED OTHERWISE.
2. VIEWING THE TRENCH FROM THE LOT, THE STORM SEWER SERVICE IS LOCATED TO THE RIGHT OF THE CURB BOX AND THE SANITARY SEWER SERVICE TO THE LEFT.
3. THE INSTALLATION SHALL BE IN ACCORDANCE WITH SEC. 504.11.00 OF WATERWORKS SPECS.
4. SEWER SERVICES MUST TERMINATE WITH A BELL OR PLAIN END SEALED WITH AN APPROVED PLUG OR CAP.
5. UNDER SUBDIVISION AGREEMENT, THE SERVICES SHALL TERMINATE INSIDE PROPERTY LINE AS SPECIFIED IN SEC. 504.11.00. W.W. CONSTRUCTIONS.
6. SERVICE LEAD PIPE SIZES:
 STORM - 75mm (REVISED SERVICE DETAIL)
 SANITARY - 100mm
7. SANITARY/STORM SERVICE LEAD TO MAIN SHALL BE WITH
 - APPROVED 100mm TEES, SADDLES OR MANUFACTURED TEE WITHIN STORM MAIN.
 - MANUFACTURED APPROVED REDUCER SHALL BE USED TO JOIN THE 75mm LEAD TO THE 100mm TEE.

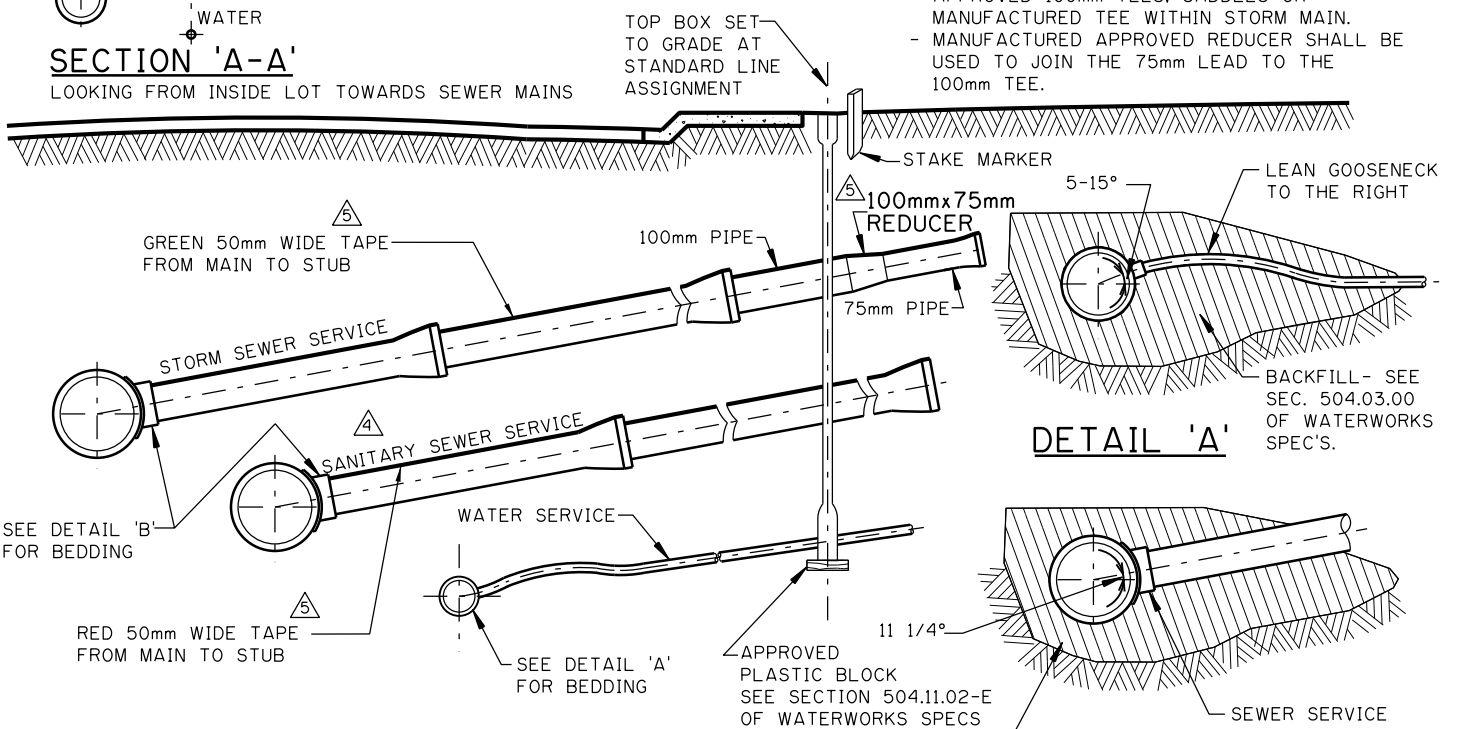

THE DEPTH OF THE WATER SERVICE PIPE AND SERVICE VALVE SHALL BE AS SPECIFIED IN SEC. 504.04.13. OF STANDARD SPECIFICATIONS.

DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE NOTED

5	2021/08/30	MODIFIED DUE TO STORM SERVICE PIPE SIZE SHORTAGE	MC
4	2021/08/30	SWITCHED PIPE DESIGNATION	MC
3	2015/04/22	ADDED SECOND - SINGLE SERVICE	EV
2	2004/11/01	SEC. REVISED FROM 504.04.12 TO 504.04.13	
1	2004/11/01	GENERAL REVISION	
No.	Date	Revision	App'd

Date
1999-09-14

Scale
N.T.S.

Approved by

for The City of Calgary

SEWER CONSTRUCTION

TYPICAL RESIDENTIAL SERVICE INSTALLATION

MODIFIED

Sheet
34M

File Number